


## A-Core Container

# Number of inverters at the capital s mobile energy storage sites

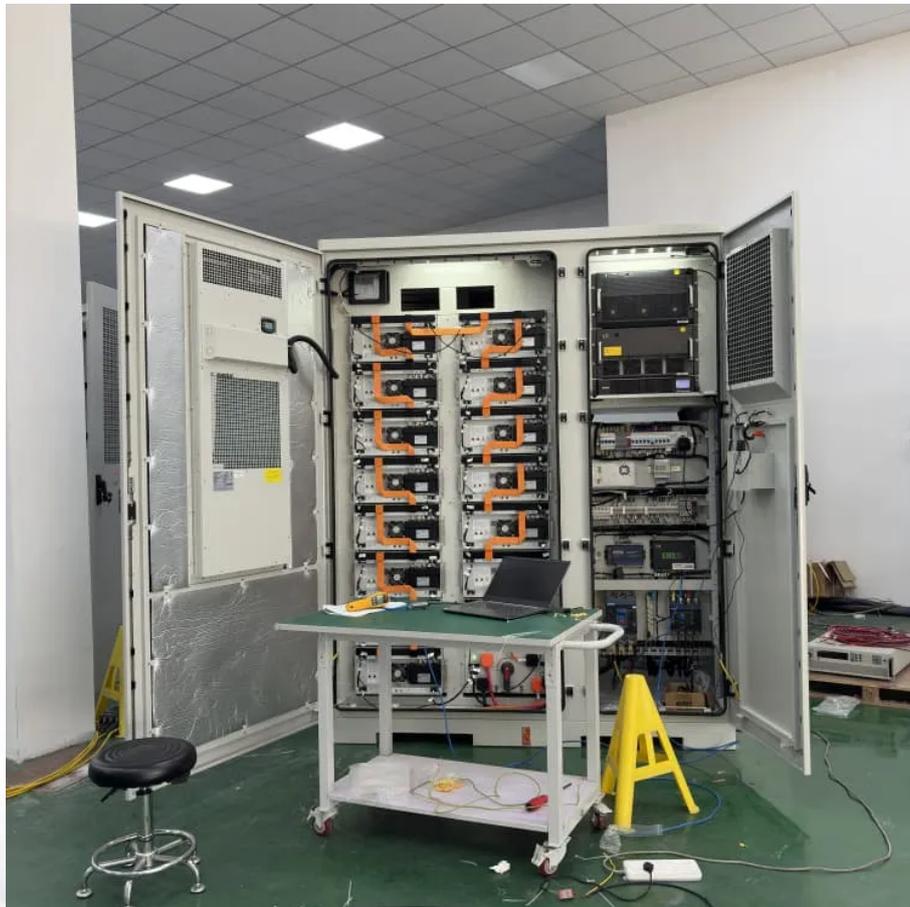

## Overview

---

How far should a mobile energy storage system be from the public?

An approved fence with a locked gate or other approved barrier shall be provided to keep the general public at least 5 feet (1024 mm) from the outer enclosure of a deployed mobile energy storage system. 1206.17.7.6 Smoking. Smoking shall be prohibited within 10 feet (3048 mm) of mobile energy storage systems.

Are battery energy storage systems permitted in a zoning district?

Tier 1 Battery Energy Storage Systems shall be permitted in all zoning districts, subject to the Uniform Code and the "Battery Energy Storage System Permit," and exempt from site plan review. 7. Permitting Requirements for Tier 2 Battery Energy Storage Systems.

Are capacitor energy storage systems required in New York State?

capacitor energy storage systems as required in section 1206 of the Fire Code of New York State. 2.5 2020 Building Code of New York State Section 916 (Gas Detection Systems) SECTION 916 GAS DETECTION SYSTEMS 916.1 Gas detection systems. Gas detection systems required by this code shall comply with Sections 916.2 through 916.11. 916.2 Permits.

Can energy storage systems be located in the same room?

Rooms and other indoor areas containing energy storage systems shall be separated from other areas of the building in accordance with Section 1206.14.4 and Chapter 7 of this code. Energy storage systems shall be permitted to be in the same room as the equipment they support. 1206.11.4 Seismic and structural design.

What is a mobile energy storage deployment?

For the purpose of Section 1206.17, deployment covers operations where mobile energy storage systems are located at a site other than the charging

and storage site and are being used to provide power. 1206.17.3 Permits.

How long does a mobile energy storage system deployment last?

The duration of a mobile energy storage system deployment shall not exceed 30 days. Exceptions: 1. Mobile energy storage system deployments that provide power for durations longer than 30 days shall comply with Section 1206.17.6. 2.

## Number of inverters at the capital s mobile energy storage sites

---

### Contact Us

---

For catalog requests, pricing, or partnerships, please visit:  
<https://www.a-core.pl>